



参考図




坊島受水場



-  : 大阪広域水道企業団送水管
-  : 既設受水管φ500
-  : 新設受水管φ400 (R4布設)
-  : 計画受水管φ400 (R5施工)
-  : 計画受水管φ400 (R6予定)

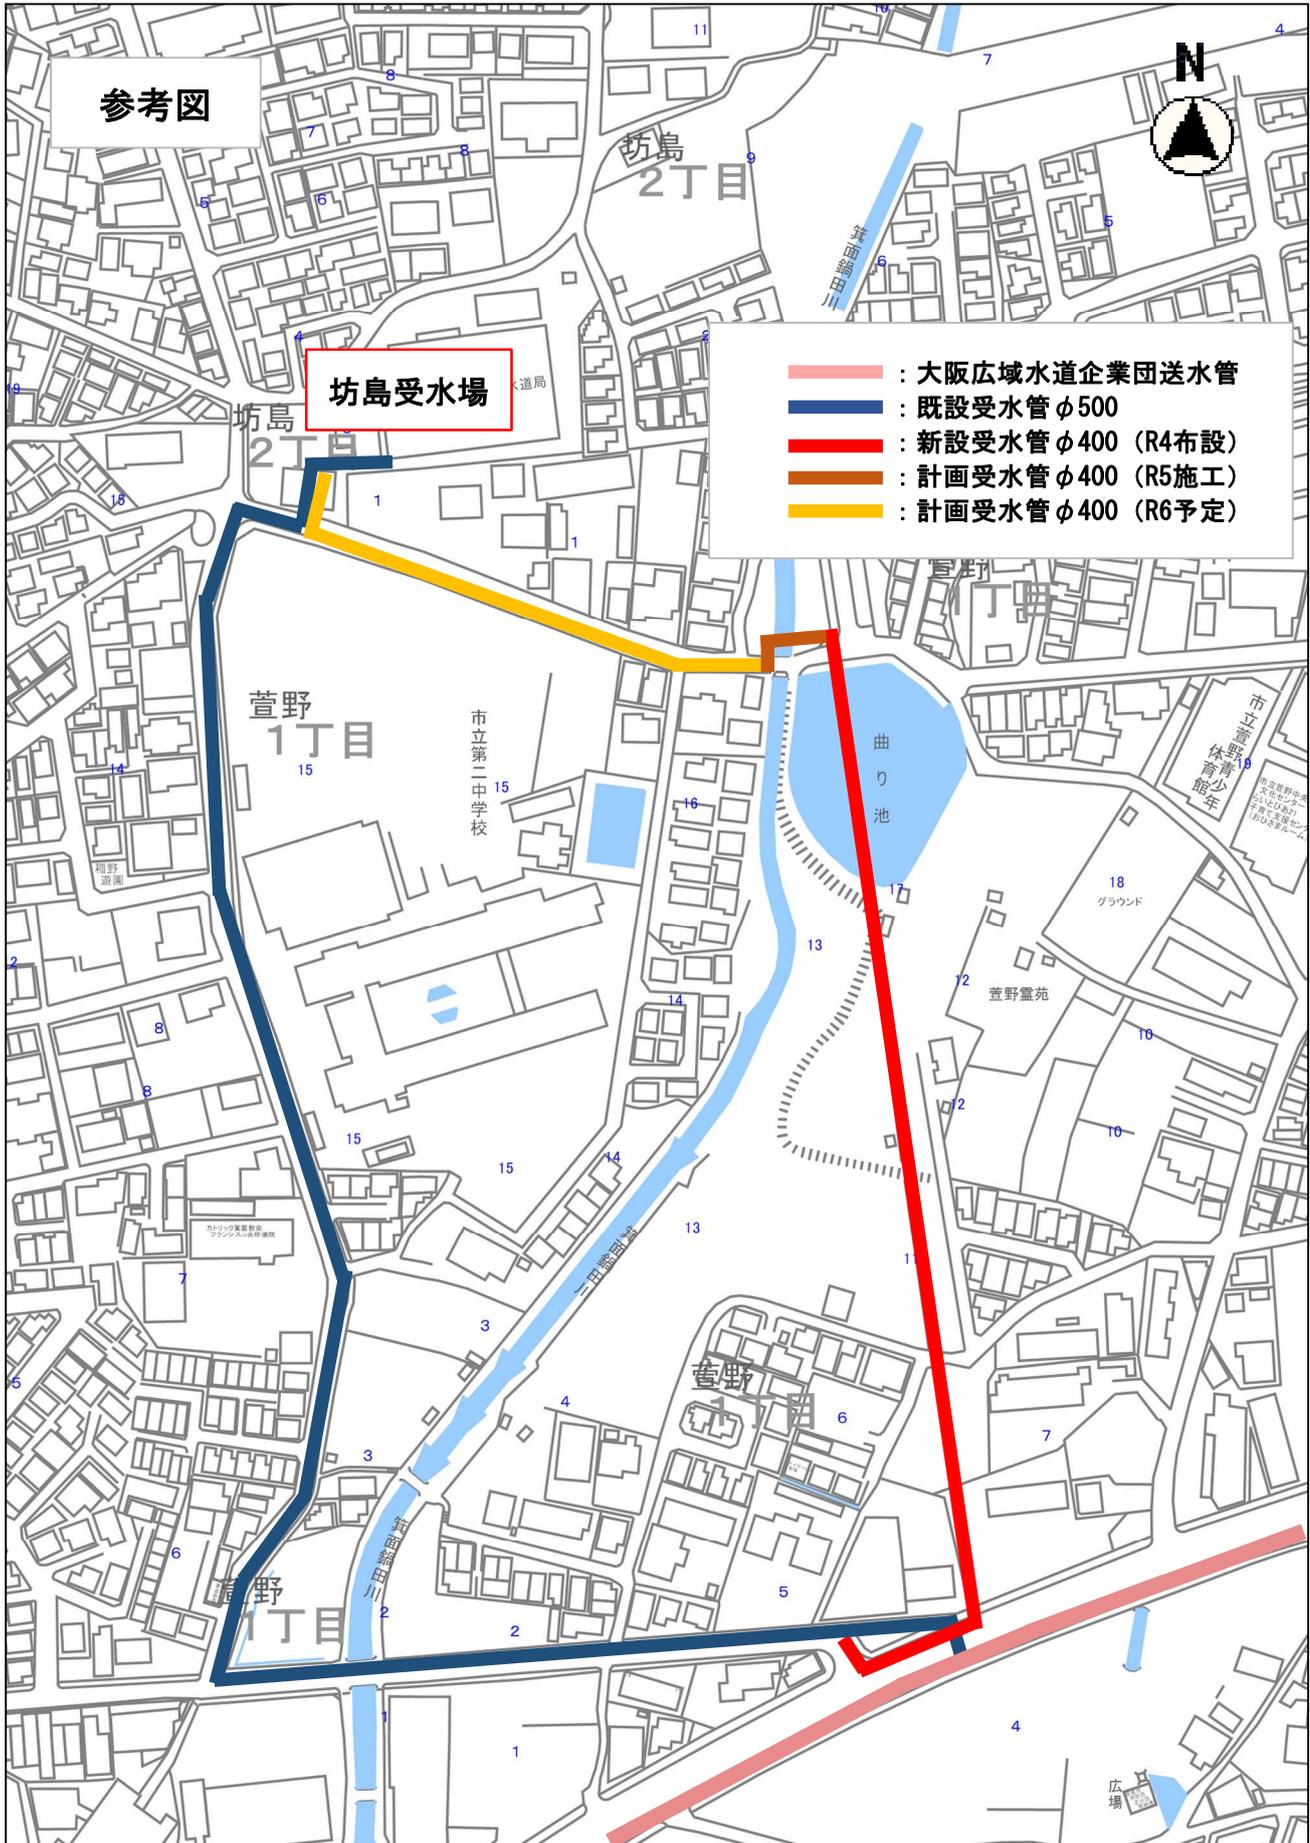

縮尺 1 : 2500



配水管布設替詳細設計業務委託NO. 1 (R5)

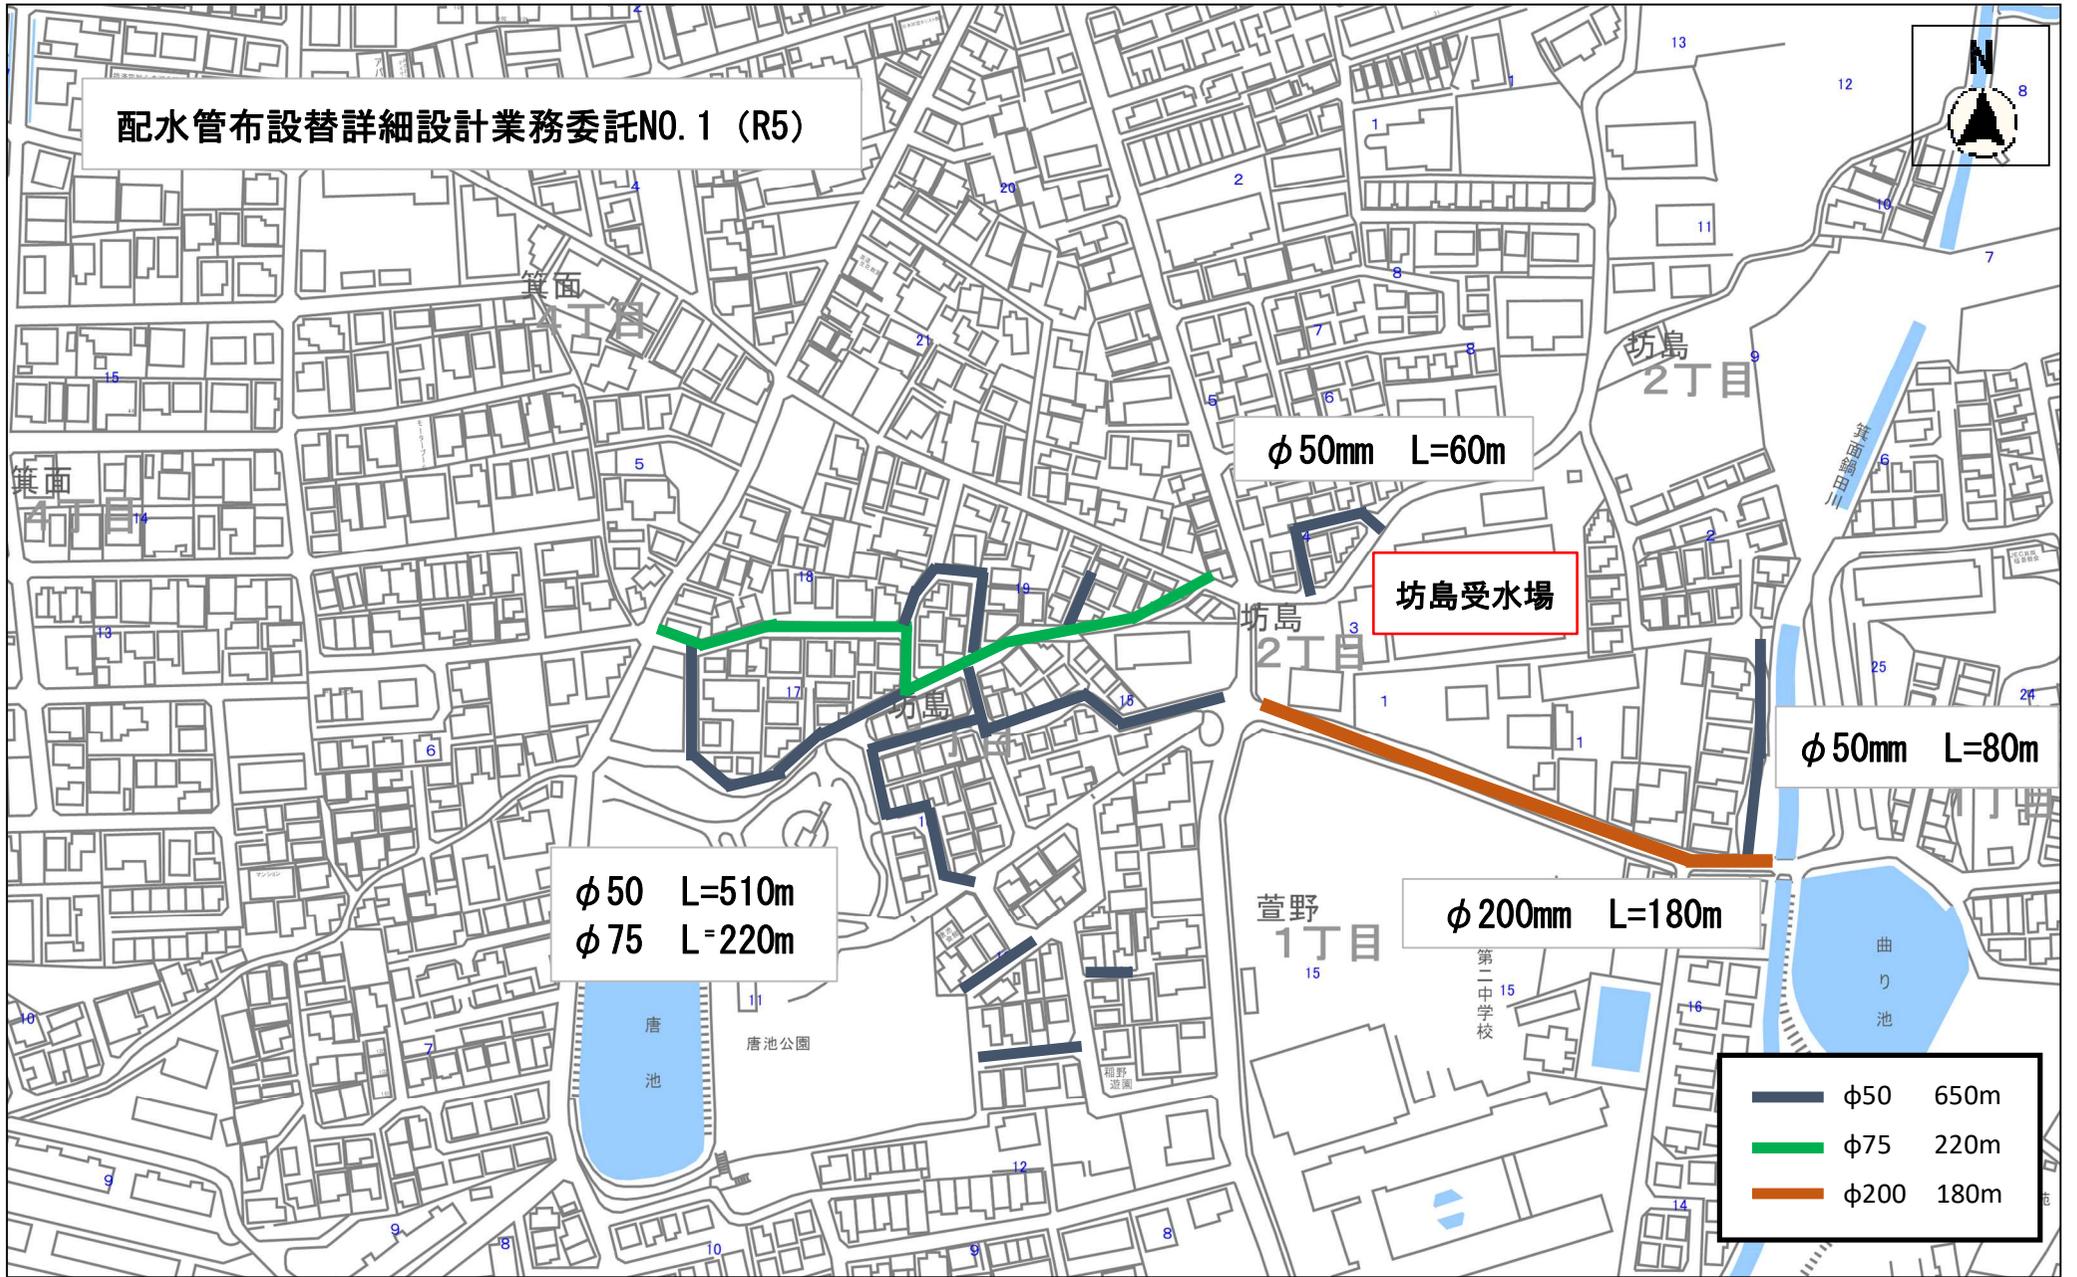

φ 50mm L=60m

坊島受水場

φ 50mm L=80m

φ 50 L=510m
φ 75 L=220m

φ 200mm L=180m

	φ50	650m
	φ75	220m
	φ200	180m

縮尺 1 : 2500

